

Issue Date: 06-11-2014
Revision Date: 06-27-2024
Renewal Date: 06-30-2025

DIVISION: 05 00 00 - METALS

Section: 05 40 00 – Cold-Formed Metal Framing

Section: 05 41 00 – Structural Metal Stud Framing

DIVISION: 09 00 00 – FINISHES

Section: 09 22 00 – Supports for Plaster and Gypsum Board

Section: 09 22 16 – Non-Structural Metal Framing

REPORT HOLDER:

ClarkDietrich Building Systems, LLC
9050 Centre Pointe Drive, Suite 400
West Chester, OH 45069
513-870-1100
www.clarkdietrich.com

REPORT SUBJECT:

MaxTrak™ Slotted Deflection Track (SLT)

MaxTrak™ 2D Slotted Deflection & Drift Track (SLT-H)

1.0 SCOPE OF EVALUATION

1.1 This Research Report addresses compliance with the following Codes:

- 2024, 2021 and 2018 *International Building Code*® (IBC)
- 2024, 2021 and 2018 *International Residential Code*® (IRC)
- 2023, 2020 *Florida Building Code* (FBC) (see Section 9.1)
- 2022 *California Building Code* (CBC) (see Section 9.2)

NOTE: This report references 2021 IBC and IRC Code sections with [FBC and CBC] Code sections shown in brackets where they differ.

1.2 *MaxTrak™* SLT and *MaxTrak™* SLT-H deflection tracks have been evaluated for the following properties:

- Structural Performance
- Fire Resistance

1.3 *MaxTrak™* SLT and *MaxTrak™* SLT-H deflection tracks are cold-formed steel framing members that serve as a connecting member that isolates the cold-formed steel framing system from the movement of the primary building structure.

1.3.1 *MaxTrak™* SLT is used for framing exterior curtain walls and non-load bearing (nonstructural) interior walls where vertical deflection occurs. Slots in the legs are designed for a total allowable vertical movement of 1-1/2 inches.

1.3.2 *MaxTrak™* SLT-H is used for framing exterior curtain walls and non-load bearing (nonstructural) interior walls where vertical deflection and horizontal drift occurs. Slots in the legs are designed for a total allowable vertical movement of 1-1/2 inches. Slots in the web are designed for a total allowable horizontal movement of 4 inches.

2.0 STATEMENT OF COMPLIANCE

MaxTrak™ SLT and *MaxTrak™* SLT-H deflection tracks comply with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.

2.1 2024 IBC and IRC Evaluation Reports

The Intertek CCRR is an *Evaluation Report* for approval of an alternate material, design, or method of construction in accordance with Section 104.2.3.6.1 of the 2024 IBC and Section R104.2.2.6.1 of the 2024 IRC.

3.0 DESCRIPTION

MaxTrak™ SLT and *MaxTrak™* SLT-H deflection tracks are fabricated from structural steel ST33H or ST50H in accordance with ASTM A1003. Steel has a coating complying with AISI S240, CP60 or CP90.

3.1 *MaxTrak™* SLT and *MaxTrak™* SLT-H deflection tracks are available in steel thicknesses of 33 mil, 43 mil, 54 mil, and 68 mil. Deflection tracks are available in widths of 2-1/2 inch, 3-5/8-inch, 4-inch, 6 inch and 8 inches. See Figure 1 and Figure 2 for track profiles.



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building



PCA-101



4.0 PERFORMANCE CHARACTERISTICS

- 4.1 Allowable lateral loads are shown in Table 2 and Table 3.
- 4.2 *MaxTrak™* SLT and *MaxTrak™* SLT-H for use in joint systems are fire rated when installed in accordance with the UL Certification XHLI.R26034.

5.0 INSTALLATION

Installation shall be in accordance with the applicable code, manufacturer's installation instructions and this report. Where differences occur between this report and the manufacturer's installation instructions, this report shall govern.

- 5.1 Fasteners attaching the *MaxTrak™* slotted deflection tracks to the structure shall be designed by a licensed design engineer to withstand the allowable lateral loads recognized in Table 2 and Table 3.
- 5.2 Cold-formed steel studs are attached to the deflection tracks with fasteners as described in Table 2 and Table 3. The installation of the screws shall be in compliance with ASTM C1007 with a minimum of three threads past the connection. Installation shall be as depicted in Figure 3, or as determined by the licensed design engineer of record.

6.0 CONDITIONS OF USE

The *MaxTrak™* slotted deflection tracks identified in this report are deemed to comply with the referenced building codes for above grade use subject to the following conditions.

- 6.1 All designs and calculations shall be prepared by a licensed design professional according to the requirements in the jurisdiction where the project is located.
- 6.2 The minimum base steel thickness of the section delivered to the jobsite must be a minimum of 95% of the design thickness.
- 6.3 The *MaxTrak™* slotted deflection tracks identified in this report are manufactured under a quality control program with inspections by Intertek Testing Services NA, Inc.

7.0 SUPPORTING EVIDENCE

- 7.1 Manufacturer's drawings and installation instructions.
- 7.2 Reports of testing and engineering analysis in accordance with ICC-ES AC46, Acceptance Criteria for Cold-Formed Steel Framing Members, October 2019, editorially revised December 2020.
- 7.3 Documentation of an Intertek approved quality control system for the manufacturing of products recognized in this report.

8.0 IDENTIFICATION

MaxTrak™ slotted deflection tracks produced in accordance with this report shall be identified with labeling at a maximum spacing of 96 inches that includes the following information:

- 8.1 The manufacturers name, logo, or initials;
- 8.2 The size and member designation
- 8.3 The minimum base steel thickness (uncoated) in decimal or mils;
- 8.4 Yield strength;
- 8.5 Galvanization coating designation: CP60 or CP90;
- 8.6 Bundles of like members shall be identified with the Intertek identification mark and Code Compliance Research Report number, CCRR-0205, as shown:





9.0 OTHER CODES

9.1 FLORIDA BUILDING CODE

9.1.1 Scope of Evaluation: The MaxTrak™ SLT and MaxTrak™ SLT-H deflection tracks were evaluated for compliance with the 2023 and 2020 Florida Building Code – Building and Florida Building Code – Residential.

9.1.2 Conclusion: The MaxTrak™ SLT and MaxTrak™ SLT-H deflection tracks, described in Sections 2.0 through 7.0 of this Research Report, comply with the 2023 and 2020 Florida Building Code – Building and Florida Building Code – Residential, including the High-Velocity Hurricane Zone provisions.

Intertek is an approved evaluation entity and quality assurance entity pursuant to Florida Statute 553.842 – Product Evaluation and Approval.

9.2 CALIFORNIA BUILDING CODE

9.2.1 Scope of Evaluation: The MaxTrak™ SLT and MaxTrak™ SLT-H deflection tracks were evaluated for compliance with the 2022 California Building Code and California Residential Code.

9.2.2 Conclusion: The MaxTrak™ SLT and MaxTrak™ SLT-H deflection tracks, described in Sections 2.0 through 7.0 of this Research Report, comply with the 2022 California Building Code and California Residential Code.

10.0 CODE COMPLIANCE RESEARCH REPORT USE

10.1 Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

10.2 Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

10.3 Reference to the https://bpdirectory.intertek.com is recommended to ascertain the current version and status of this report.

TABLE 1 – CODE REFERENCED STANDARDS

| 2024 and 2021 IBC and IRC | 2018 IBC and IRC | 2023 FBC | 2020 FBC | 2022 CBC |
|--|------------------------------|--|------------------------------|--|
| AISI S100-16(2020) w/S2-20 AISI S240-20 | AISI S100-16 AISI S240-15 | AISI S100-16(2020) w/S2-20 AISI S240-20 | AISI S100-16 AISI S240-15 | AISI S100-16(2020) w/S2-20 AISI S240-20 |

This Code Compliance Research Report (“Report”) is for the exclusive use of Intertek’s Client and is provided pursuant to the agreement between Intertek and its Client. Intertek’s responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.



TABLE 2 - MAXTRAK™ ALLOWABLE LATERAL LOADS (INTERIOR LOCATION) ^{1, 2, 3, 4}

| MaxTrak™ Slotted Deflection Track Material Properties | | | Fastener Description | Stud At Interior Location | | | | |
|--|--------------------------|-------|----------------------|---|--|---|---|-----------------------------------|
| Design Thickness (inch) | Designation Thickness | | | Min. Yield Strength (ksi) | Allowable Lateral Load (lbs) ⁽¹⁾ | Safety Factor, Ω ⁽⁶⁾ | Resistance Factor, ϕ ⁽⁶⁾ | Nominal Lateral Strength (lbf) |
| | Mil | Gauge | | | | | | |
| 0.0346 | 33 | 20 | 33 | #8 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 156 lbs | 2.92 | 0.548 | 456 |
| 0.0451 | 43 | 18 | 33 | #10 wafer-head self-drilling screws, minimum, 0.43" head diameter ⁽⁵⁾ | 205 lbs | 2.92 | 0.548 | 599 |
| 0.0566 | 54 | 16 | 50 | #10 wafer-head self-drilling screws, minimum, 0.43" head diameter ⁽⁵⁾ | 360 lbs | 2.92 | 0.548 | 1051 |
| 0.0713 | 68 | 14 | 50 | #10 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 537 lbs | 2.92 | 0.548 | 1568 |

Notes:

1. The allowable lateral loads limit the transverse deflection to a 1/8" service limit.
2. The minimum wall stud thickness must be equal to the MaxTrak™ thickness.
3. Stud to track connection must be installed as depicted in Figure 3 with a maximum gap of 7/8" between the web of the deflection track and the end of the stud.
4. Studs located greater than 12" from the end of the MaxTrak™.
5. Fasteners shall comply with SAE J78 and ASTM C954.
6. Safety and resistance factors have been determined in accordance with AISI S100-16, Section K2.1 [AISI S100-12, Section F1.1]



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building

PCA-101

TABLE 3 - MAXTRAK™ ALLOWABLE LATERAL LOADS (JAMB LOCATION) ^{1, 2, 3, 4}

| MaxTrak™ Slotted Deflection Track Material Properties | | | Fastener Description | Stud At Jamb Location | | | | |
|--|--------------------------|-------|----------------------|--|---|---|---|-----------------------------------|
| Design Thickness (inch) | Designation Thickness | | | Min. Yield Strength (ksi) | Allowable Lateral Load (lbs) ⁽¹⁾ | Safety Factor, Ω ⁽⁶⁾ | Resistance Factor, ϕ ⁽⁶⁾ | Nominal Lateral Strength (lbf) |
| | Mil | Gauge | | | | | | |
| 0.0346 | 33 | 20 | 33 | #8 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 100 | 2.97 | 0.539 | 297 |
| 0.0451 | 43 | 18 | 33 | #10 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 133 | 2.97 | 0.539 | 395 |
| 0.0566 | 54 | 16 | 50 | #10 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 237 | 2.97 | 0.539 | 704 |
| 0.0713 | 68 | 14 | 50 | #10 wafer-head self-drilling screws, minimum 0.43" head diameter ⁽⁵⁾ | 355 | 2.97 | 0.539 | 1054 |

Notes:

1. The allowable lateral loads limit the transverse deflection to a 1/8" service limit.
2. The minimum wall stud thickness must be equal to the MaxTrak™ thickness.
3. Stud to track connection must be installed as depicted in Figure 3 with a maximum gap of 7/8" between the web of the deflection track and the end of the stud.
4. Studs located within 12" of the end of the MaxTrak™.
5. Fasteners shall comply with SAE J78 and ASTM C954.
6. Safety and resistance factors have been determined in accordance with AISI S100-16, Section K2.1 [AISI S100-12, Section F1.1]



545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building

PCA-101

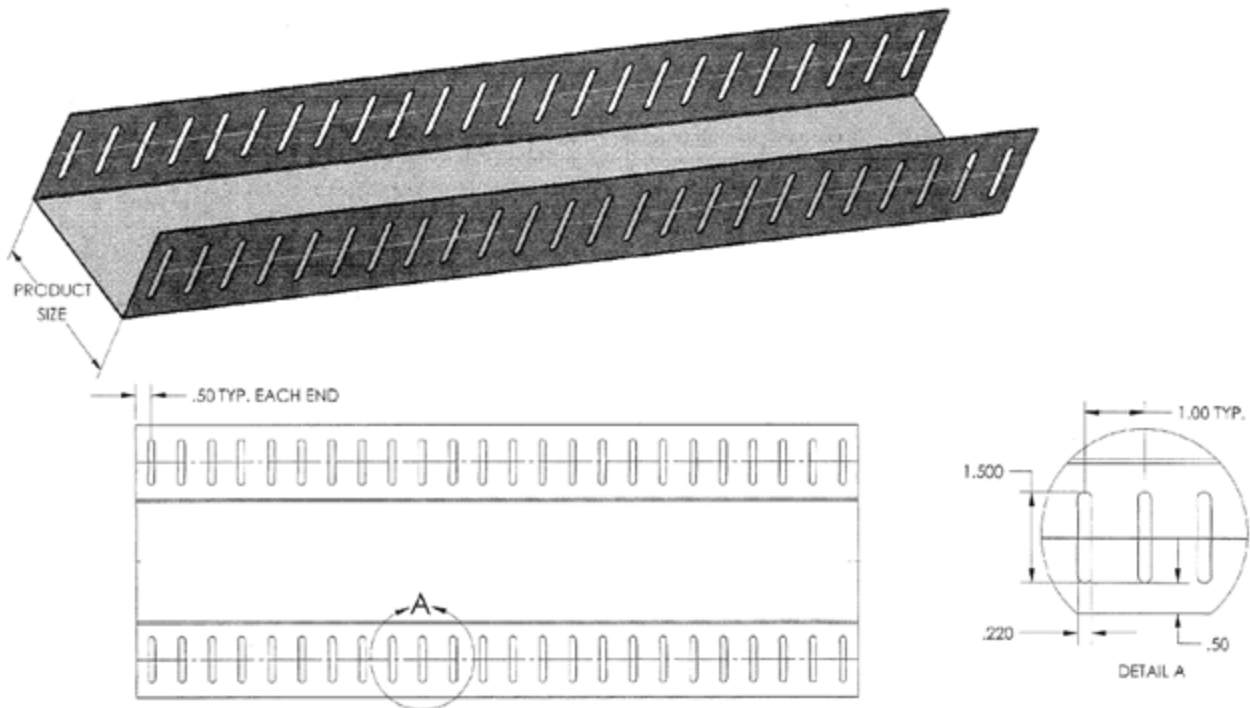


FIGURE 1 – MAXTRAK™ SLOTTED DEFLECTION TRACK (SLT) DETAIL

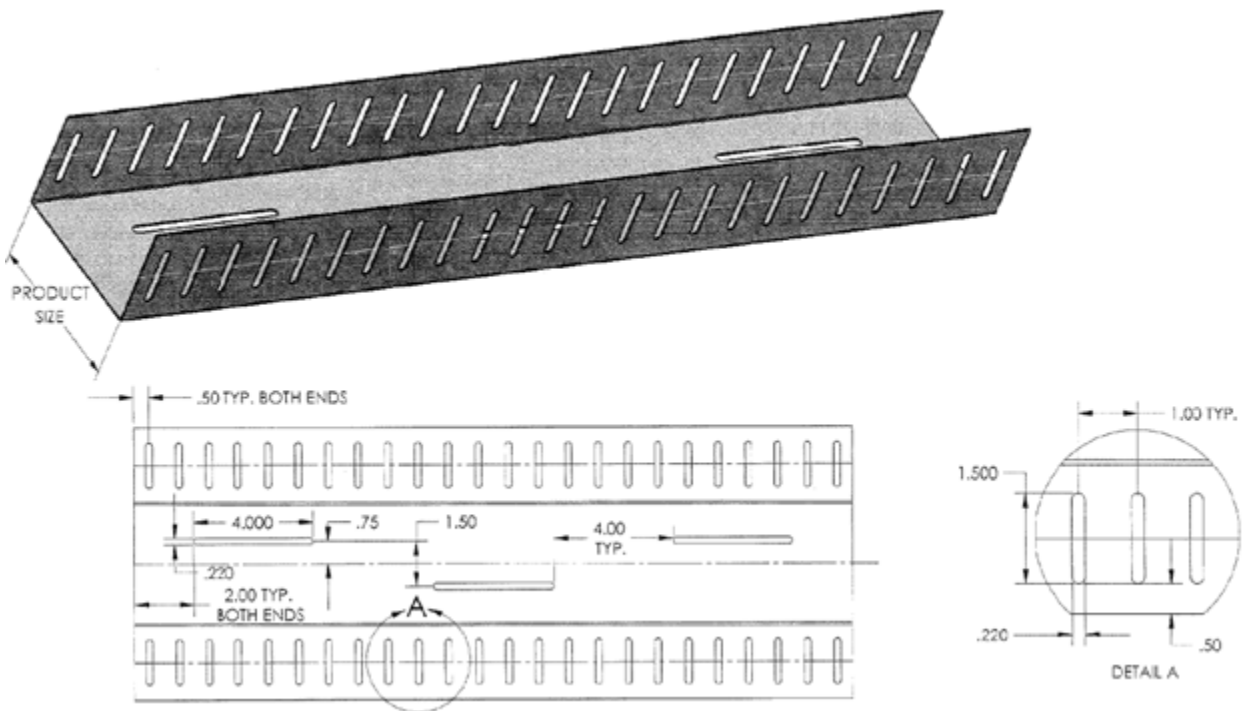


FIGURE 2 – MAXTRAK™ SLOTTED DEFLECTION & DRIFT TRACK (SLT-H) DETAIL

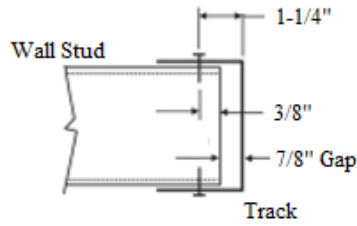


FIGURE 3 – STUD TO TRACK CONNECTION DETAIL



Intertek

545 E. Algonquin Road • Arlington Heights • Illinois • 60005

intertek.com/building



PCA-101