

Issue Date: 03-07-2024
Revision Date: 03-19-2026
Renewal Due: 03-31-2027

DIVISION: 07 00 00 – THERMAL AND MOISTURE PROTECTION
Section: 07 42 13.19 – Insulated Metal Wall Panels

REPORT HOLDER:
Metl-Span, A Nucor Company
700 State Highway 121 Bypass, Suite 200
Lewisville, TX 75067
972-221-6656
www.metlspan.com

REPORT SUBJECT:
CF Wall Panels with PIR Core
CF-24, CF-30, CF-36, CF-42 and CF-44
Insulated Metal Panels

1.0 SCOPE OF EVALUATION

1.1 This Research Report addresses compliance with the following Codes:

- 2024, 2021 and 2018 *International Building Code*® (IBC)
- 2025 and 2022 *California Building Code* (CBC) (See Section 9.0)
- 2023 *City of Los Angeles Building Code* (LABC) (See Section 9.1)

NOTE: This report references the most recent edition of the Codes cited. Section numbers in earlier versions of the Codes may differ.

1.2 CF Wall Panels with PIR Core have been evaluated for the following properties (see Table 1):

- Structural (Wind Resistance)
- Weather Resistance
- Fire Performance

1.3 CF Wall Panels with PIR Core have been evaluated for the following uses (see Table 1):

- Exterior wall cladding on non-fire-resistance-rated wall assemblies
- Type V construction
- Type I, II, III or IV construction when installed in accordance with the conditions specified in Section 6.4

2.0 STATEMENT OF COMPLIANCE

CF Wall Panels with PIR Core comply with the Codes listed in Section 1.1, for the properties stated in Section 1.2 and uses stated in Section 1.3, when installed as described in this report, including the Conditions of Use stated in Section 6.

2.1 2024 IBC and IRC Evaluation Reports: The Intertek CCRR is an *Evaluation Report* for approval of an alternate material, design, or method of construction in accordance with Section 104.2.3.6.1 of the 2024 IBC and Section R104.2.2.6.1 of the 2024 IRC.

3.0 DESCRIPTION

3.1 General: The CF Wall Panel with PIR Core is a composite metal sandwich panel consisting of a continuously foamed-in-place polyisocyanurate (PIR) foam plastic insulation core between steel facings. When installed in accordance with the manufacturer's instructions and this report, CF Wall Panels with PIR Core form a weather-resistant exterior wall envelope in accordance with IBC section 1402.2.

The panels are available in thicknesses of 2, 2-1/2, 3, 4, 5, 6, and 8 inches. The panels are available in standard widths of 24, 30, 36, 42, and 44 inches. The panel model numbers correspond to the widths: CF-24, CF-30, CF-36, CF-42 and CF-44. The panels are available in five shallow exterior face profiles: Architectural Flat, Flute, Mesa, Light Mesa, and Striated.

3.2 Panel Core: The CF Wall Panels with PIR Core core is a continuously foamed-in-place polyisocyanurate (PIR) foam plastic.

3.3 Exterior Panel Facings: The CF Wall Panels with PIR Core exterior panel facing is formed from steel conforming to ASTM A792 SS Grade 33 AZ50 galvalume steel or ASTM A653 SS Grade 33 G90 galvanized steel. Panel facings can be 22-gauge, 24-gauge or 26-gauge thickness. Panel facings can come in six different shallow profiles (see Figure 1):



A: "Architectural Flat" profile
F: "Flute" profile
M: "Mesa" profile
L: "Light Mesa" profile
S: "Striated" profile
SFe: "Santa Fe" profile

3.4 Interior Liner: The CF Wall Panel with PIR Core interior liner is formed from steel conforming to ASTM A792 SS Grade 33 AZ50 galvalume steel or ASTM A653 SS Grade 33 G90 galvanized steel. Panel facings can be 22-gauge, 24-gauge or 26-gauge thickness.

4.0 PERFORMANCE CHARACTERISTICS

4.1 Structural (Wind Resistance): Maximum allowable moment, shear, end clip reactions, intermediate clip reactions and stiffness values for use in design with allowable stress design wind speeds (V_{asd}) in accordance with IBC Section 1609.3.1 are presented in Table 2 for FP1, V6 and V6+ fastening conditions.

4.2 Fire Performance:

4.2.1 The foam plastic core and all panel finishes have a flame spread index (FSI) not exceeding 15 and a smoke developed index (SDI) not exceeding 450 when tested in accordance with ASTM E84.

4.2.2 CF Wall Panel with PIR Core assemblies constructed in accordance with Intertek Design Number MSN/CWP 30-02 meet the conditions of acceptance of NFPA 285.

4.3 Weather Resistance: CF Wall Panels with PIR Core, when installed in accordance with this report, provide a weather-resistant exterior wall envelope based on testing in accordance with ASTM E331 and IBC Section 1402.2.

5.0 INSTALLATION

5.1 General: CF Wall Panels with PIR Core must be installed in accordance with the manufacturer's published installation instructions, the applicable Code, and this Research Report. A copy of the manufacturer's instructions must be available on the jobsite during installation.

5.2 Application: CF Wall Panels with PIR Core may be installed in either a vertical or horizontal orientation. Panels are fastened to structural steel supports by U-clip brackets, or V6 X-Span clips and fasteners placed in the tongue and groove portion of the panel (see Figure 2).

5.3 Sealant: CF Wall Panels with PIR Core are sealed along edges by factory-applied, non-curing butyl gasket beads located within the double tongue and groove connection.

Additional sealant (optional) - a nominal 3/16-inch bead of one-component urethane or butyl sealant may be applied in the field to the female edge of the panel on either the exterior side, interior side or both sides prior to joining the panels.

5.4 Flashings and Trim: Flashing and trim must be installed in accordance with Section 1404.4 of the IBC including, but not limited to, panel ends, openings and corners.

6.0 CONDITIONS OF USE

6.1 Installation must comply with this Research Report, the manufacturer's published installation instructions, and the applicable Code. In the event of a conflict, this report governs.

6.2 Design loads determined from allowable stress design wind speeds (V_{asd}) in accordance with IBC Section 1609.3.1 shall be used to calculate the panel bending moment, shear force and panel anchor reaction loads and shall not exceed the corresponding maximum allowable design values given in Table 2. Panel deflection calculations at design load shall include bending deflection and shear deflection using the panel stiffness properties in Table 2 and shall not exceed $L/120$, where (L) is the panel span.

6.3 The calculations for connections from the CF Wall Panels with PIR Core to the supporting structure must be performed by a qualified engineer and are not part of this report.

6.4 Types I, II, III, or IV Construction: CF Wall Panels with PIR Core may be installed on buildings of Type I, II, III or IV construction under the following conditions:





Buildings of any height with the wall assembly constructed in accordance with Intertek Design Number MSN/CWP 30-02.

6.5 CF Wall Panels with PIR Core may be installed without an approved thermal barrier based on testing in accordance with NFPA 286 per IBC Section 2603.9.

6.6 CF Wall Panels with PIR Core are manufactured under an approved quality control program with inspections by Intertek Testing Services NA, Inc. at the following locations:

- Hamilton, Ontario
- Laurens, South Carolina
- Waterloo, Indiana
- Brigham City, Utah
- Prince George, Virginia
- Shelbyville, Indiana

7.0 SUPPORTING EVIDENCE

7.1 Reports of tests in accordance with ASTM E84-21a, ASTM E119-20, NFPA 285-23 and NFPA 286-23.

7.2 Reports of test in accordance with ASTM E331-00 (2016) and IBC Section 1402.2.

7.3 Data in accordance with the ICC-ES Acceptance Criteria AC04 Acceptance Criteria for Sandwich Panels (Approved June 2019, editorially revised August 2024).

7.4 Intertek Listing Report “Metl-Span CF Wall Panel with PIR Core Insulated Metal Panels Listing Information” on the Intertek Directory of Building Products.

8.0 IDENTIFICATION

CF Wall Panels with PIR Core are identified with the manufacturer’s name (Metl-Span), address and telephone number, the product name (CF Wall Panels), the Intertek Mark as shown below, and the Code Compliance Research Report number (CCRR-0508).



9.0 CALIFORNIA BUILDING CODE

The CF wall panels with PIR core Insulated Metal Panels, described in Sections 2.0 through 7.0 of this Research Report, comply with the *California Building Code*, and *California Residential Code* for the editions indicated in Section 1.1 of this report, subject to the following conditions:

- Use of the CF wall panels with PIR core Insulated Metal Panels for compliance with the Wildland-Urban Interface (WUI) provisions of CBC Chapter 7A and CRC Section R337 has not been evaluated, and is outside the scope of this Research Report.

9.1 CITY OF LOS ANGELES BUILDING CODE

The CF wall panels with PIR core Insulated Metal Panels, described in Sections 2.0 through 7.0 of this Research Report, comply with the *City of Los Angeles Building Code*, and *City of Los Angeles Residential Code*, for the editions indicated in Section 1.1 of this report, subject to the following conditions:

- Use of the CF wall panels with PIR core Insulated Metal Panels for compliance with the Wildland-Urban Interface (WUI) provisions of LABC Chapter 7A and LARC Section R337 has not been evaluated, and is outside the scope of this Research Report.

10.0 CODE COMPLIANCE RESEARCH REPORT USE

10.1 Approval of building products and/or materials can only be granted by a building official having legal authority in the specific jurisdiction where approval is sought.

10.2 Code Compliance Research Reports shall not be used in any manner that implies an endorsement of the product by Intertek.

10.3 Reference to <https://bpdirectory.intertek.com> is recommended to ascertain the current version and status of this report.



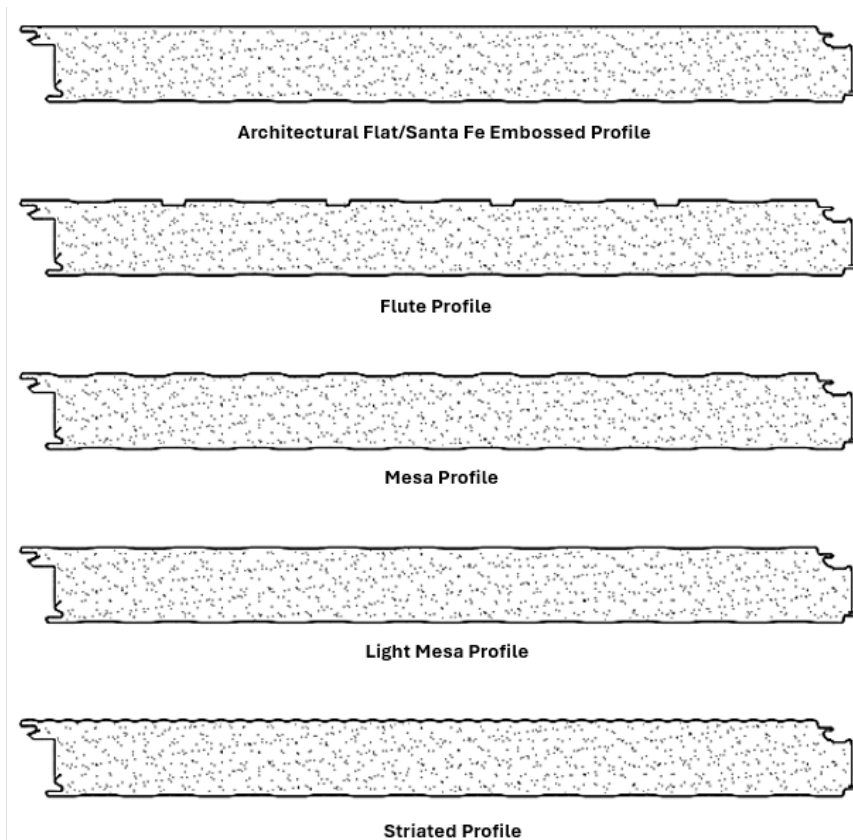


Figure 1 – CF Wall Panel with PIR Core Profiles

TABLE 1 – PROPERTIES EVALUATED

PROPERTY	2024, 2021, and 2018 IBC SECTION	2022 and 2025 CBC SECTION	2023 LABC SECTION
Structural (Wind Resistance)	1609	1609	1609
Weather Resistance	1402.2	1402.2	1402.2
Surface Burning	2603.3 and 2603.5	2603.3 and 2603.5	2603.3 and 2603.5
Use on exterior walls of Types I, II, III, and IV construction	2603.5	2603.5	2603.5
Thermal Barriers	2603.4 and 2603.9	2603.4 and 2603.9	2603.4 and 2603.9

This Code Compliance Research Report (“Report”) is for the exclusive use of Intertek’s Client and is provided pursuant to the agreement between Intertek and its Client. Intertek’s responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this Report. Only the Client is authorized to permit copying or distribution of this Report and then only in its entirety, and the Client shall not use the Report in a misleading manner. Client further agrees and understands that reliance upon the Report is limited to the representations made therein. The Report is not an endorsement or recommendation for use of the subject and/or product described herein. This Report is not the Intertek Listing Report covering the subject product and utilized for Intertek Certification and this Report does not represent authorization for the use of any Intertek certification marks. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek.






TABLE 2 – ALLOWABLE DESIGN VALUES
Metl-Span CF Wall Panel with PIR Core Allowable Design Values

Panel Thickness (in)	Stiffness		Moment (ft-lb/ft)	Shear (lb/ft)	Reactions		
	EI (lb-in ² /ft)	AG (lb/ft)			Fastener Pattern	End Clip Reaction (lb)	Intermediate Clip Reaction (lb)
2"	1.25E+07	1.30E+04	321	157	FP1	243	752
					V6	N/A	N/A
					V6+	N/A	N/A
2.5"	1.96E+07	1.63E+04	418	172	FP1	254	797
					V6	N/A	N/A
					V6+	N/A	N/A
3"	2.83E+07	2.00E+04	515	186	FP1	266	841
					V6	250	801
					V6+	438	N/A
4"	5.04E+07	2.65E+04	716	243	FP1	355	1,180
					V6	374	1,170
					V6+	615	N/A
5"	7.89E+07	3.30E+04	970	338	FP1	337	1,139
					V6	358	1,284
					V6+	657	N/A
6"	1.14E+08	3.97E+04	1,223	432	FP1	324	1,099
					V6	347	1,398
					V6+	699	N/A
8"	2.03E+08	5.11E+04	1,223	436	FP1	324	1,099
					V6	347	1,398
					V6+	699	N/A

Notes:


1. Allowable design loads were calculated using Allowable Strength Design for the following limit states: panel bending (failure of face or liner skin), panel core shear (failure of foam core), disengagement (at panel end connections or intermediate connections), and specified deflection limit as required (no greater than L/120).
2. Safety factors for panels were calculated based on AISI S100 to be 2.14 for Moment; 3.0 for Shear; 2.14-2.57 for End Reaction; and 2.14-2.47 for Intermediate Clip Reaction.
3. See Figure 2 below for details of fastening with Metl-Span's U (FP1) and V6 X-Span clips. V6 X-Span clips are not for use with panels less than 3" in thickness.
4. Values for panel shear and bending strength are unit values per 12" unit width of panel.
5. Core shear stiffness values (AG) are effective values derived from full-profile panel tests and shall not be taken as a core material properties. They are limited to use in calculating the deflection for the specific panel configuration to which they are assigned.
6. Allowable design values address panel failure modes only. Fastener failure must be determined separately based on panel, span, and fastening substrate.



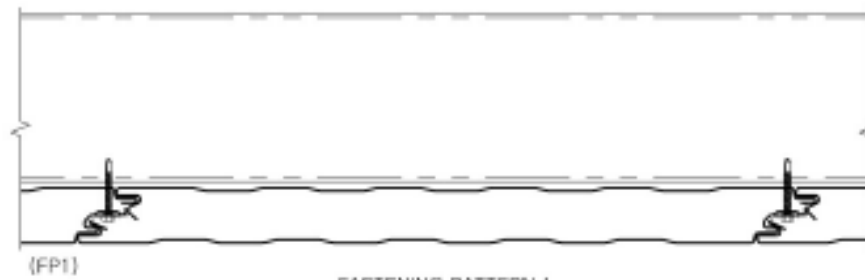

(FP1)


FASTENING PATTERN I
SIDE JOINT FASTENING

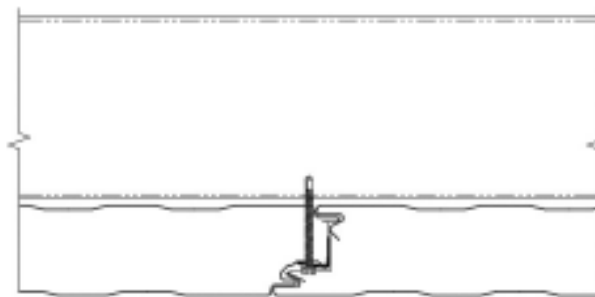

(V6)

ONE V6 X-SPAN CLIP AT EACH SUPPORT

MINIMUM 3"-THICK PANEL

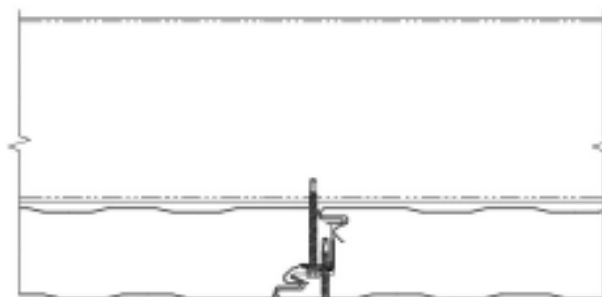

(V6+)

ONE V6 X-SPAN CLIP AT EACH SUPPORT
WITH ONE FACE-TO-CLIP FASTENER AT
PANEL ENDS ONLY

INSTALL 2"-LONG FACE-TO-CLIP FASTENER
THROUGH PANEL FACE TONGUE AND
ADJACENT PANEL CLIP, 1.5" FROM PANEL
JOINT

MINIMUM 3"-THICK PANEL

Figure 2 – Fastening Patterns FP1, V6, and V6+